Placement Instructions For Air Conditioning

The unit can be placed in the drain pan flat or on its side depending upon the space between the cooling coil and the drain pan.

SMALL UNIT - FOR EQUIPMENT UP TO 5 TONS
LARGE UNIT - FOR EQUIPMENT OVER 5 TONS AND UP TO 15 TONS

NOTE: FOR LARGER EQUIPMENT USE MULTIPLE UNITS

SMALL UNIT for Vertical or Horizontal Coil



Space between coil and drain pan is more than 3/8". Place unit under cooling coil in middle of pan length, pad side down. Unit must be in contact with condensate. Do not remove unit housing.

SMALL UNIT for "A" Coil or Slant Coil



Space between coil and drain pan is less than 3/8". Place unit on its side between coil and pan edge in the middle of pan length, pad side down. Unit must be in contact with condensate. Do not remove unit housing.

LARGE UNIT for Air Conditioning Equipment Up To 15 Tons



Space between coil and drain pan is usually several inches high. Place unit under cooling coil in middle of pan length, pad side down. Unit must be in contact with condensate. Do not remove unit housing. Use multiple units for equipment over 15 tons.

IMPORTANT:

1. **DO NOT USE IN:**
   - **HUMIDIFIERS**
   - **HUMIDIFIER SECTIONS OF AIR CONDITIONING SYSTEMS**
   - **EVAPORATIVE COOLERS**
2. **Clean condensate drain pan before installing unit.**
3. **Place in pan, pad side down, under cooling coil in middle of pan length. Do not remove unit housing.**
4. **REMOVE unit from Dual Heating/Air Conditioning equipment before converting to heating use.**

Specifications

Chemical Specifications -

Active Ingredients: Alkyl (60% C14, 30% C16, 5% C12, 5% C18) Dimethyl Benzyl Ammonium Chloride	- 20%
Alkyl (68% C12, 32% C14) Dimethyl Ethylbenzyl Ammonium Chloride	- 20%
Inert Ingredients:	- 60%
Total:	-100%

Mechanical Specifications - SMALL UNIT - 2 3/4" long x 2 1/4" wide by 1/2" high, contents 3/4 oz.
LARGE UNIT - 3 5/8" long x 2 3/4" wide by 7/8" high, contents 2 1/8 oz.

All statements and specifications are subject to change without notice.

Patent Pending EPA Reg. # 33427-4

Placement Instructions For Commercial Refrigeration

The unit can be placed in the drain pan flat or at an angle, depending upon the space between the refrigeration coil and the drain pan, pad side down.

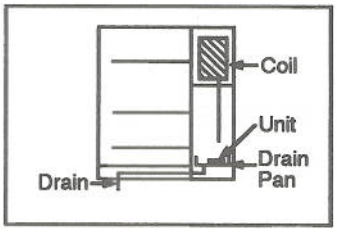

Beverage & Grocery Reach-In Coolers

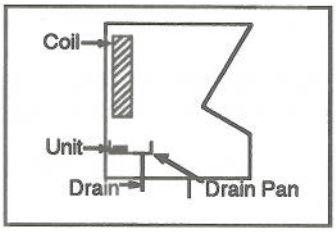

Refrigerated Display Cases

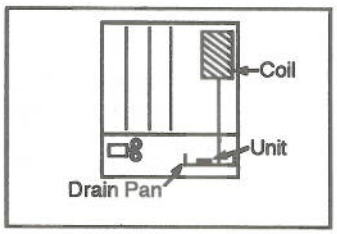

Refrigerated Vending Machines

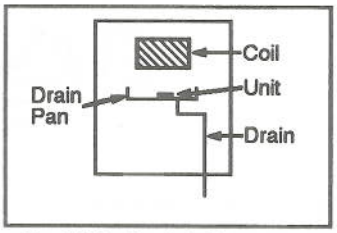

Cold & Cold Storage Walk-Ins

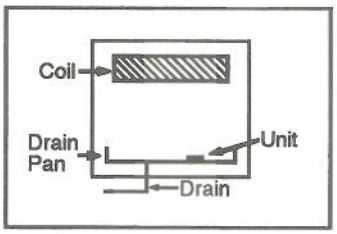

Ice Makers

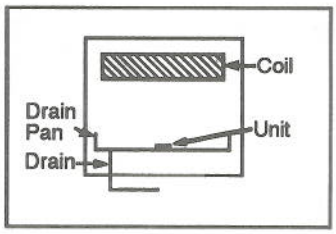

Beer Coolers

Directions For Use

It is a violation of Federal law to use this product in a manner inconsistent with its labeling.

1. **DO NOT USE IN:** HUMIDIFIERS, HUMIDIFIER SECTIONS OF AIR CONDITIONING SYSTEMS OR EVAPORATIVE COOLERS.
2. Clean condensate pan and drain before installing unit.
3. Place unit in pan, pad side down.
4. In pans with drain connections, place unit under the cooling coil in the middle of pan length.
5. Unit must be in contact with condensate.
6. This unit is designed and approved only for use in drain pans of Air Conditioning Systems and Refrigeration Systems.

Do Not Remove Unit Housing.
Do Not Place Unit In Drain Pans Above Food Products.
Replace Unit Every 3 Months.

Precautionary Statements

HAZARD TO HUMANS AND DOMESTIC ANIMALS
DANGER

CORROSIVE. Causes irreversible eye damage and skin burns. Do not get in eyes, on skin or clothing. Wear chemical goggles, protective clothing and rubber gloves. May be fatal if swallowed, absorbed through the skin, or inhaled. Wash thoroughly with soap and water after handling and before eating, drinking, chewing gum, or smoking tobacco. Remove contaminated clothing and wash before reuse.

ENVIRONMENTAL HAZARDS: This product is toxic to fish.

FIRST AID:

If in eyes:
- Hold eye open and rinse slowly and gently with water for 15-20 minutes.
- Remove contact lenses, if present, after the first 5 minutes, then continue rinsing eye.
- Call a poison control center or doctor for treatment advice.

If on skin:
- Take off all contaminated clothing.
- Rinse skin immediately with plenty of water for 15-20 minutes.
- Call a poison control center or doctor for treatment advice.

If swallowed:
- Call a poison control center or doctor immediately for treatment advice.
- Have person sip a glass of water if able to swallow.
- Do not induce vomiting unless told to do so by the poison control center or doctor.
- Do not give anything by mouth to an unconscious person.

If inhaled:
- Move person to fresh air.
- If person is not breathing, call 911 or an ambulance, then give artificial respiration, preferably mouth-to-mouth if possible.
- Call a poison control center or doctor for further treatment advice.

Have the product container or label with you when calling a poison control center or doctor, or going for treatment. For emergency information on product, usage etc., call 1-800-424-9300.

NOTE TO PHYSICIAN: Probable mucosal damage may contraindicate the use of gastric lavage.